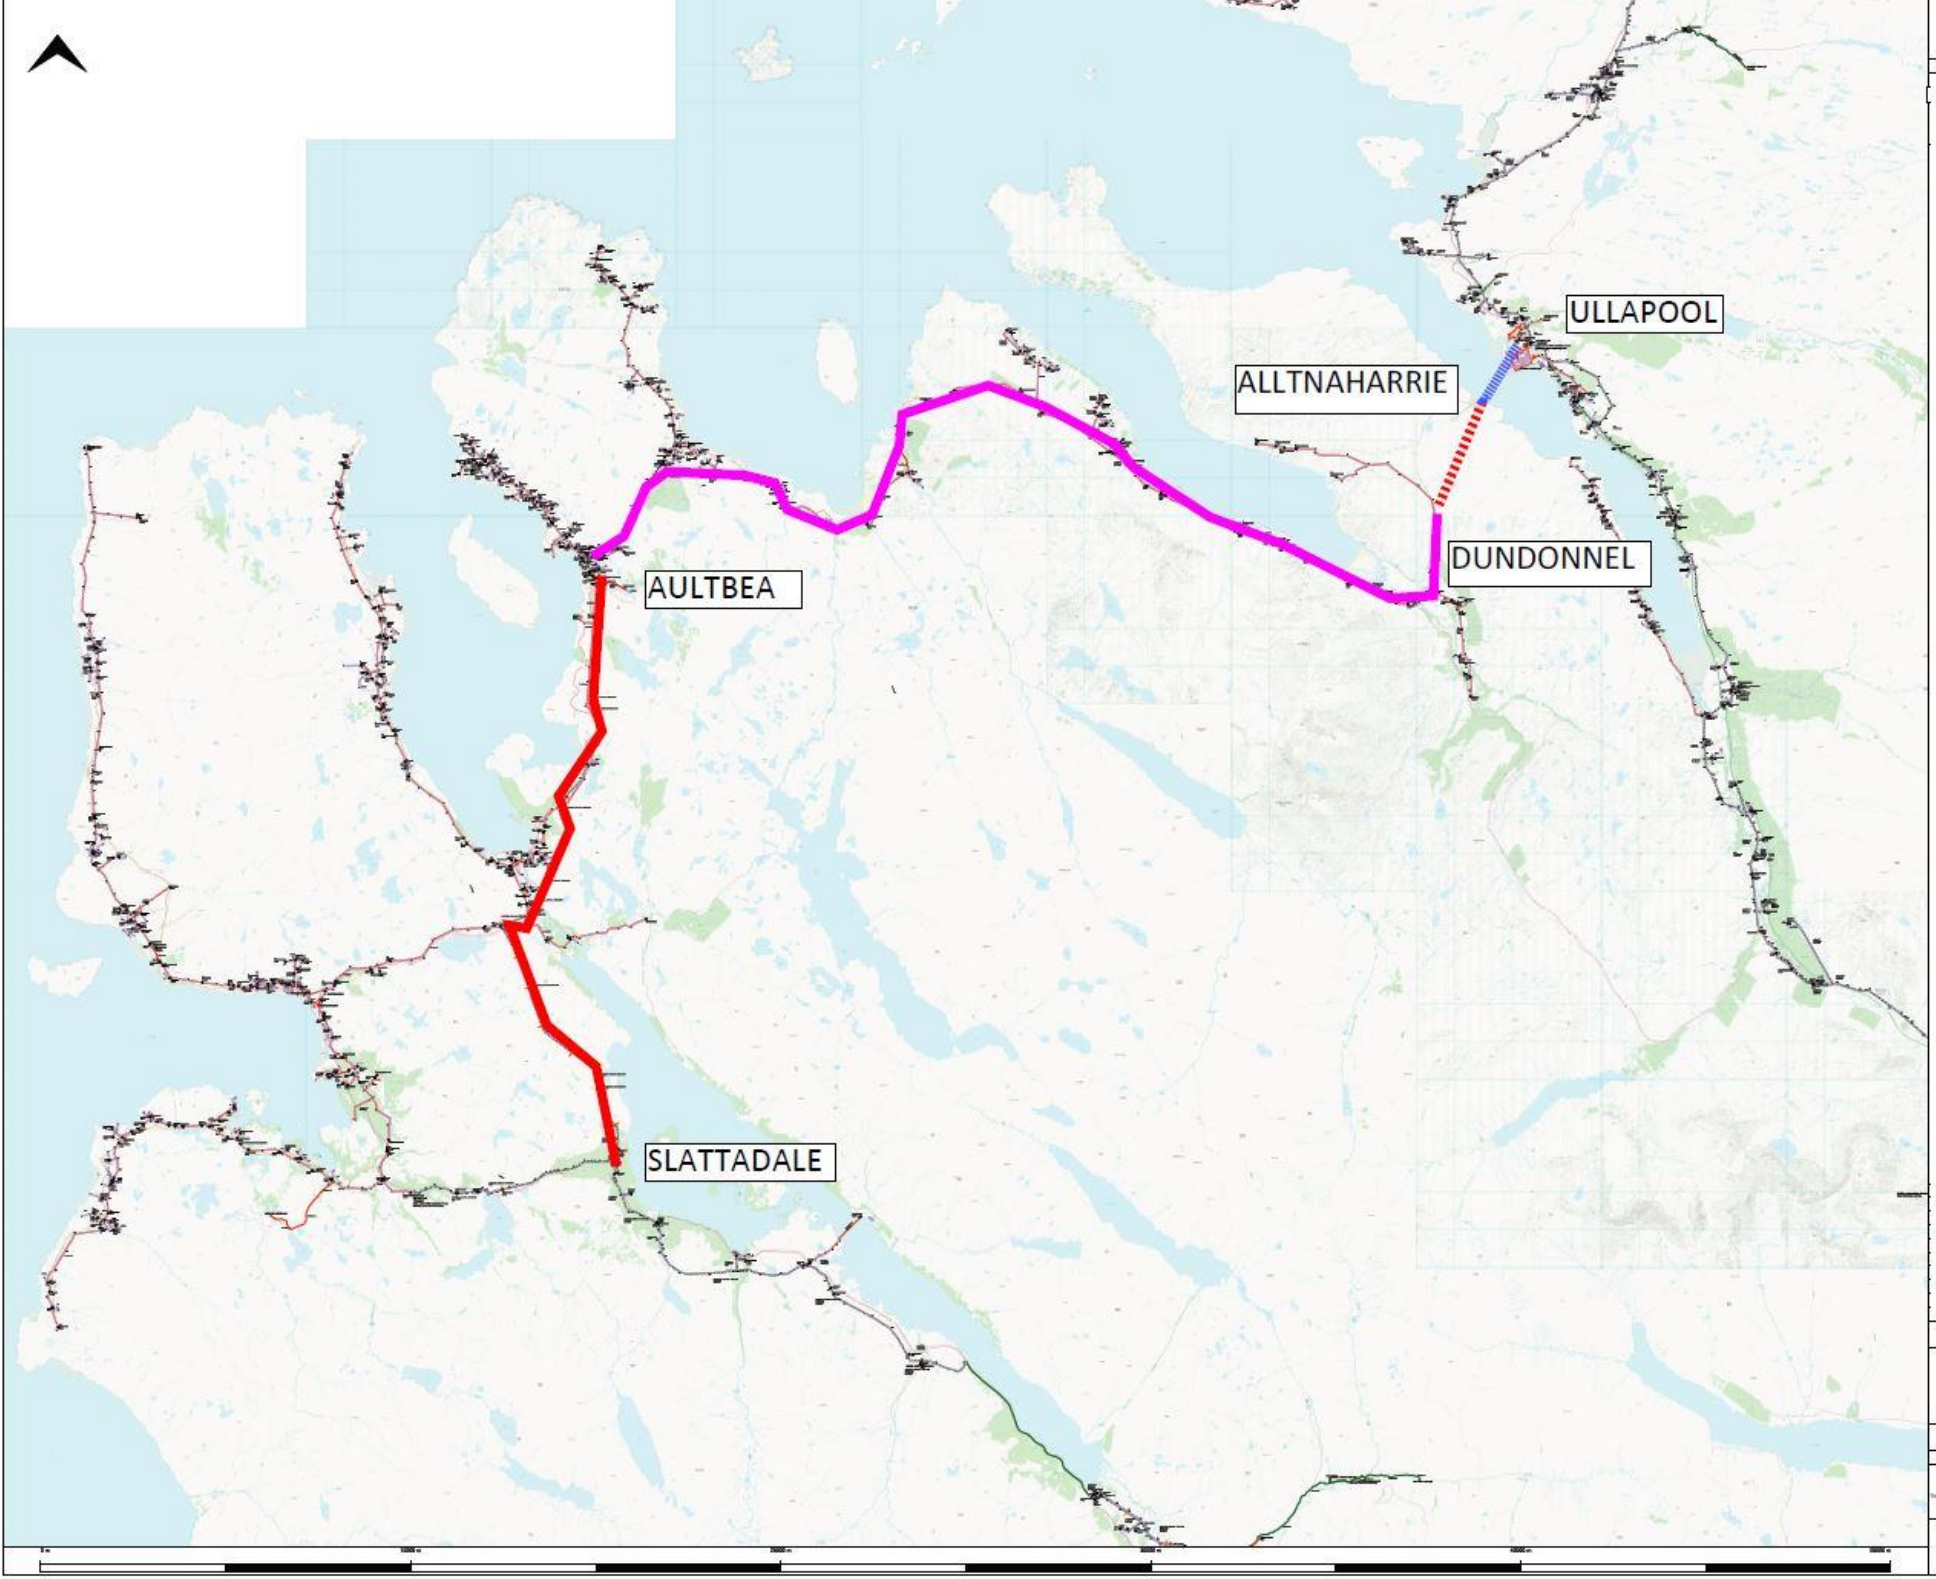

Scottish & Southern Electricity Networks

Map Centre: 197813, 883185	Grid Ref: NG97818318
Scale: 1:75000	Plot Date: 18/05/2021

REBUILD EXISTING 33kV OHL

UPGRADE EXISTING 11kV OHL TO 33kV

NEW 33kV OHL

NEW SUBMARINE CABLE

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

If you are unsure & need to seek advice before commencing excavations please contact;

General Enquiries	0800 048 3516

BASED UPON THE ORDNANCE SURVEY MAP WITH THE DIRECTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

This map has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd, pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright, the copy must not be copied without the prior permission of the copyright owner.

Scottish and Southern Energy Power Distribution Ltd
Registered in Scotland No. SC213459
Registered Office: Inveralmond House, 200 Dunkeld Road, Perth, PH1 3AQ